


1/19

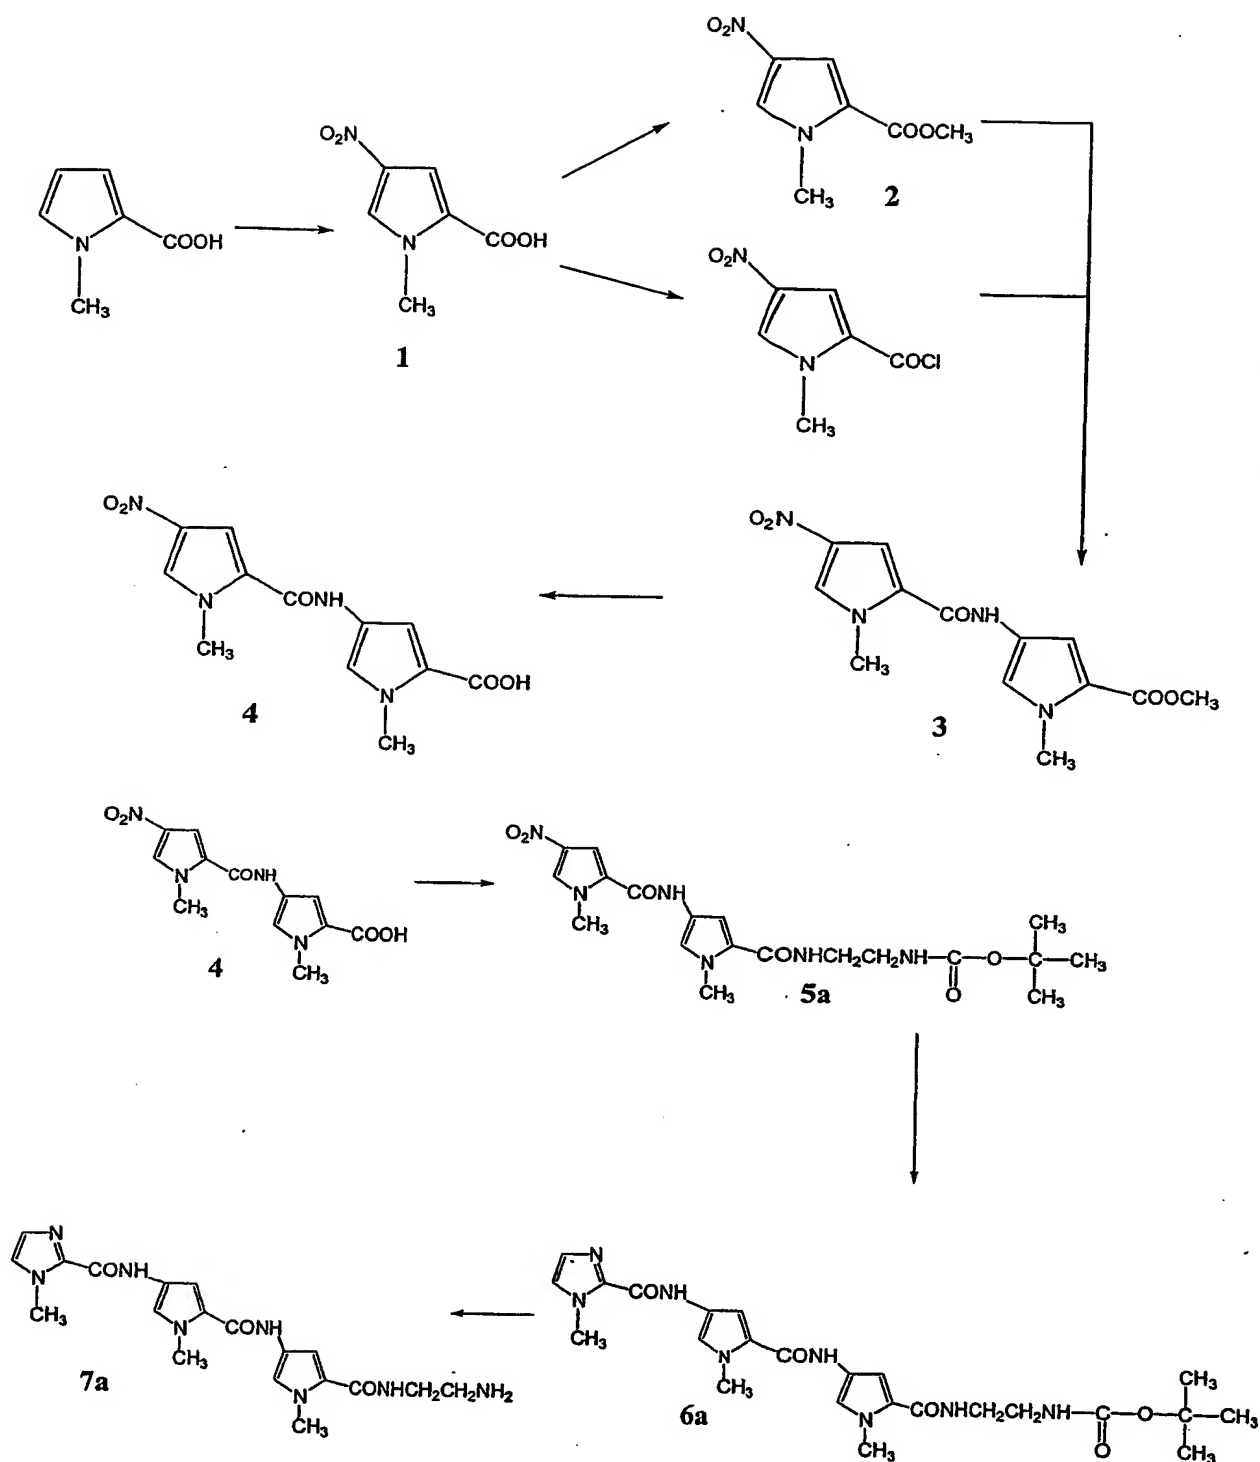

### Figure 1

**Best Available Copy**

2/19

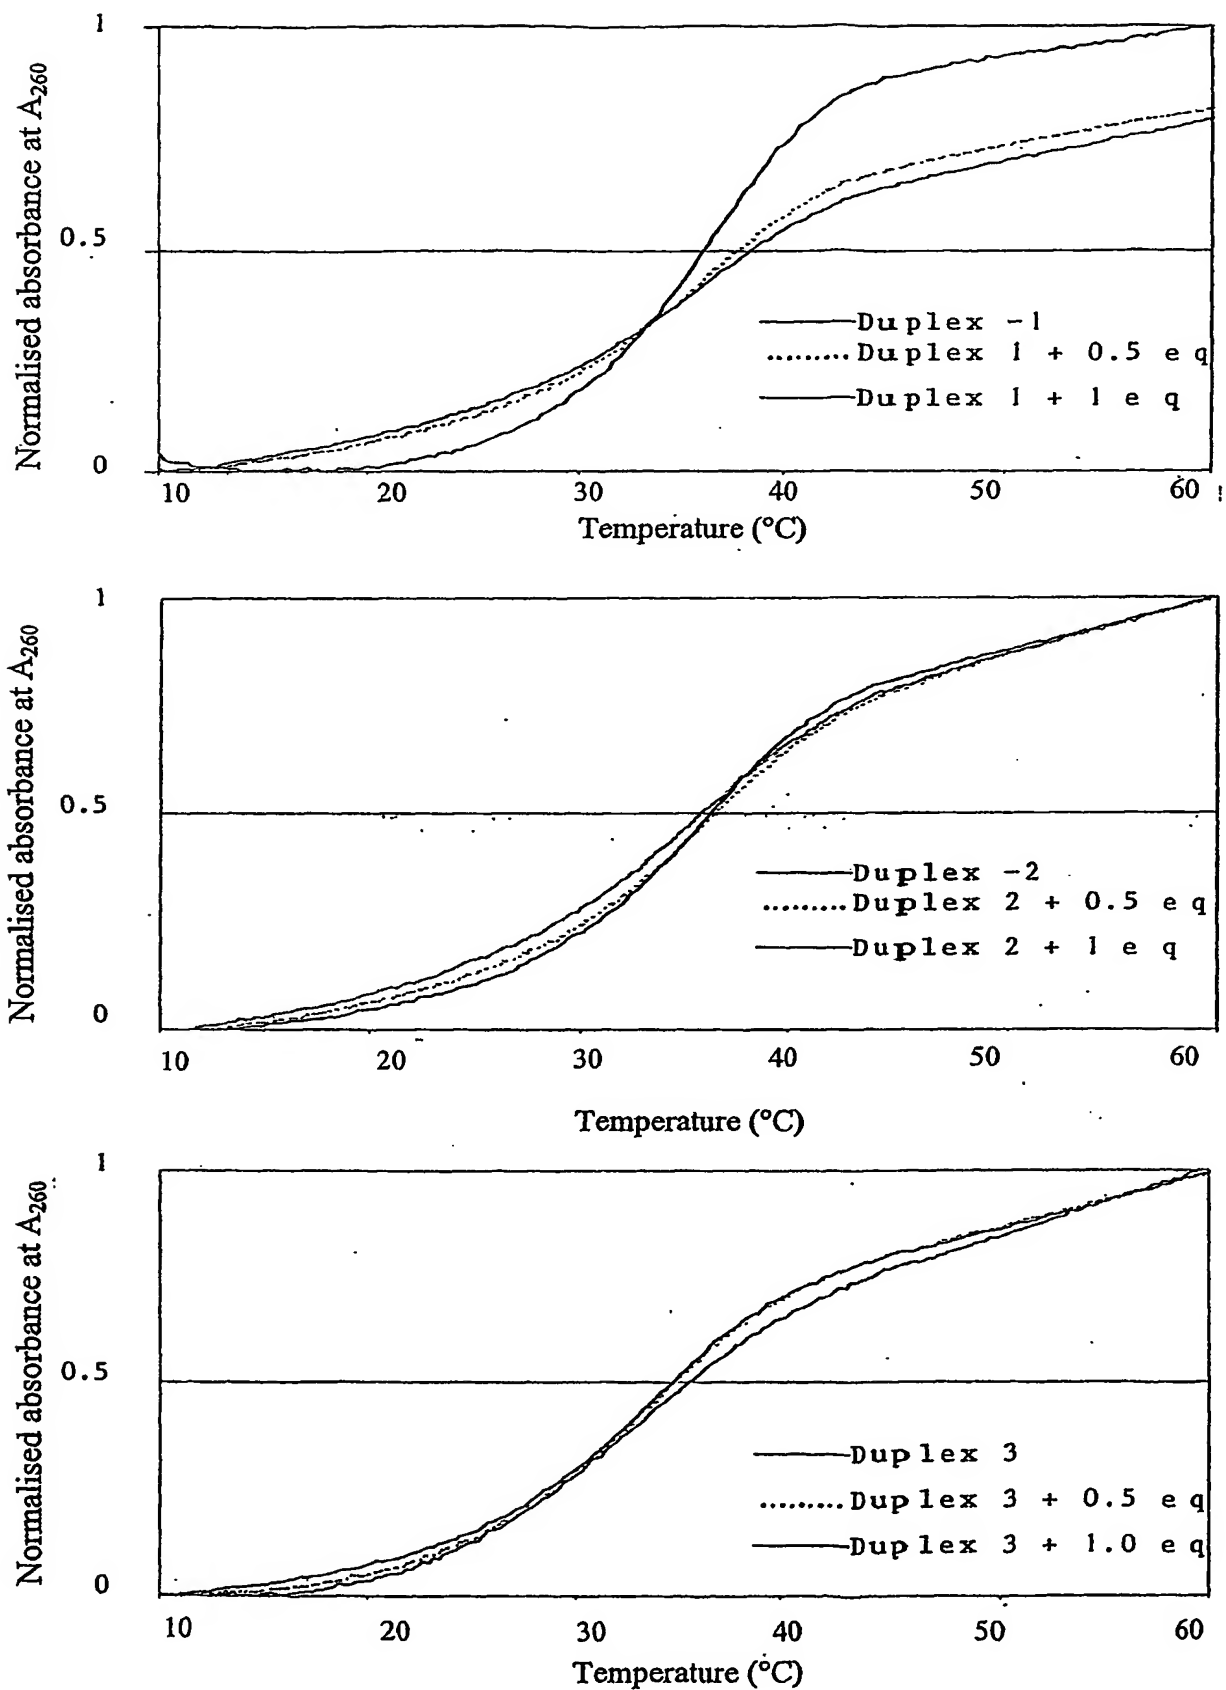


Figure 2

CD titration Spectra

ICD titration Spectra

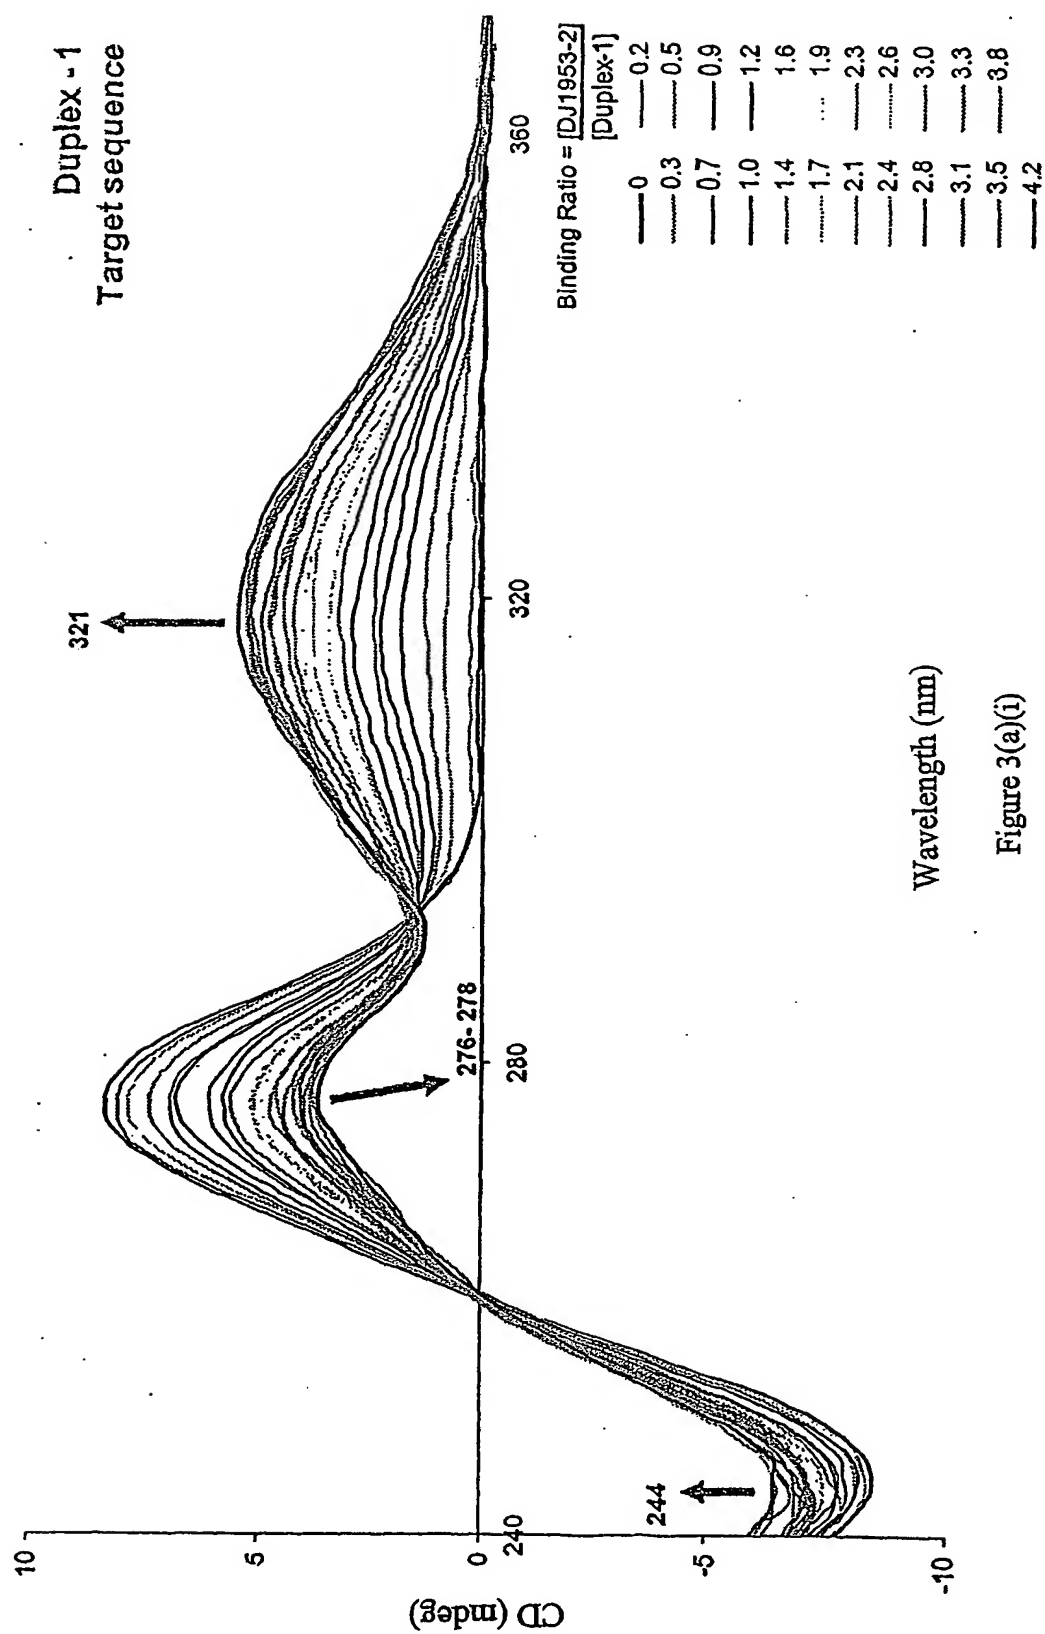
DJ1953-2 trans-lm/Py/Py-[CONH(CH<sub>2</sub>)<sub>2</sub>-NH<sub>2</sub>)Pt(NH<sub>3</sub>)<sub>2</sub>Cl

Figure 3(a)(i)

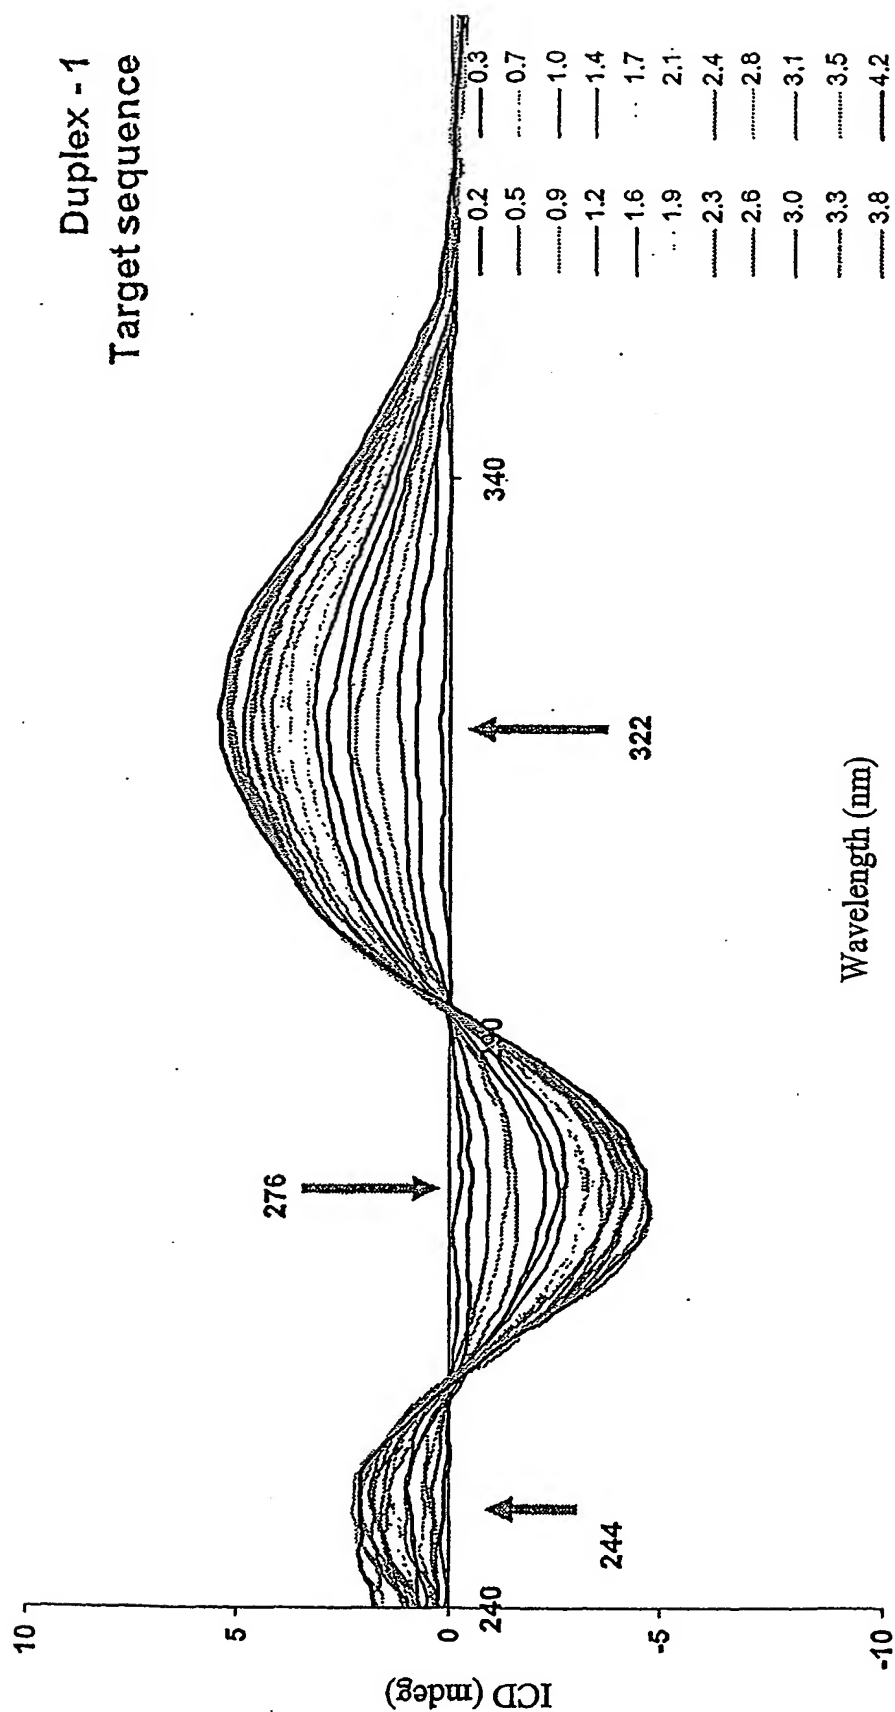


Figure 3(a)(ii)

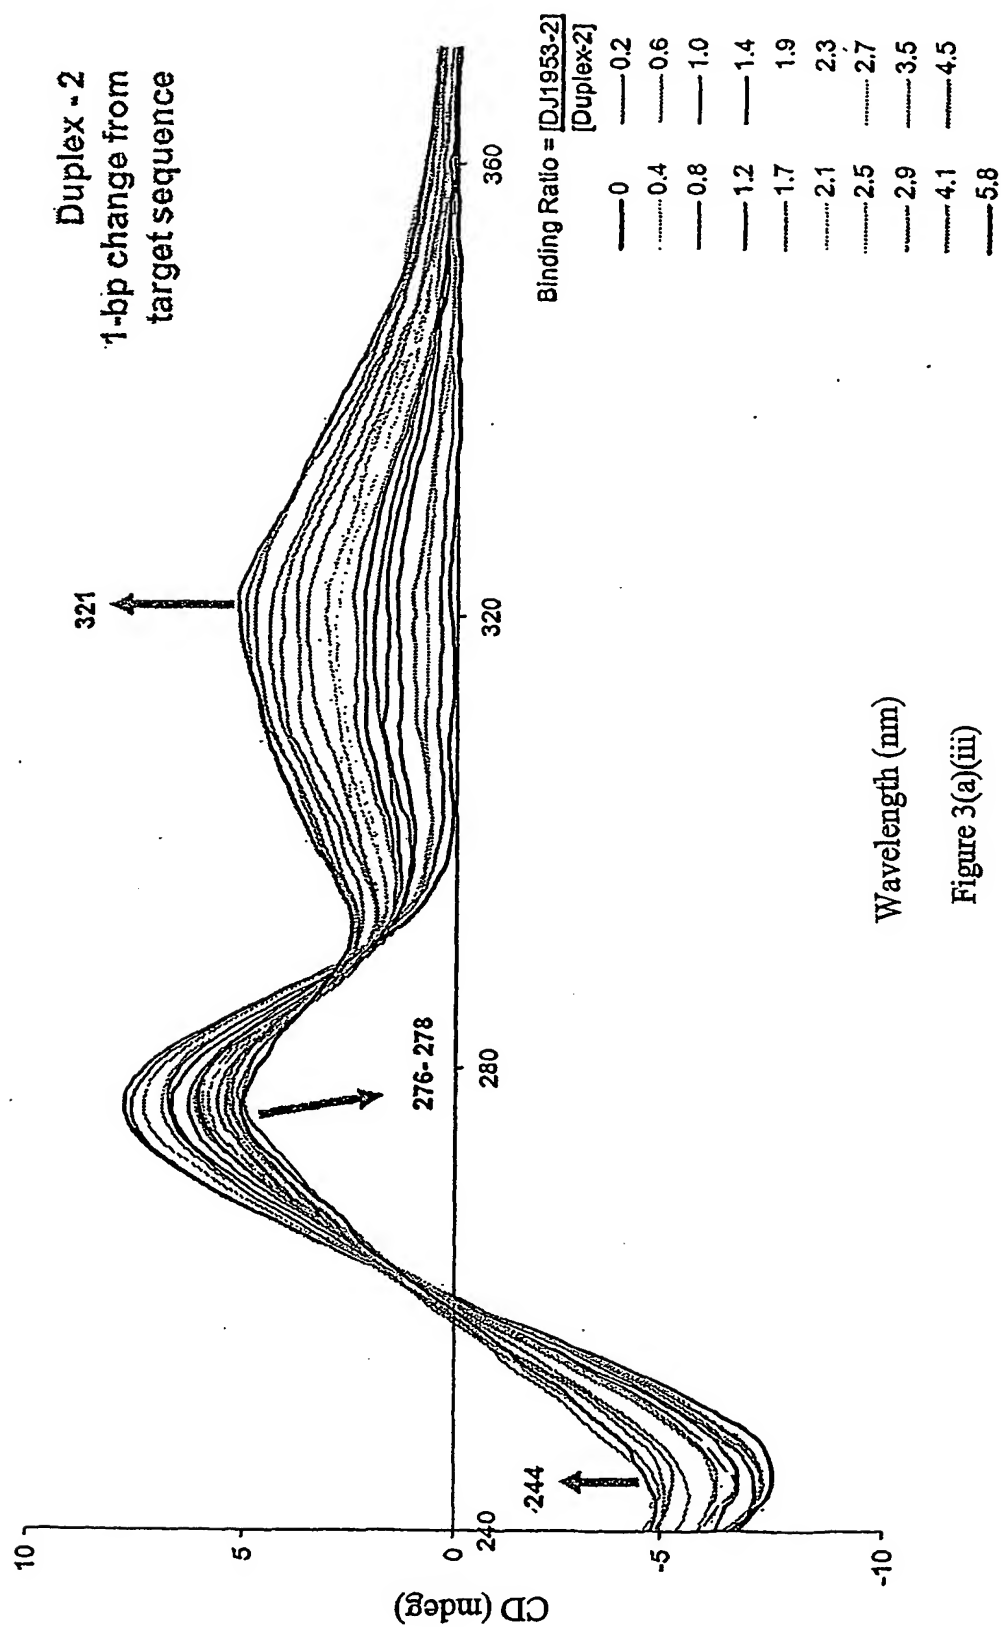


Figure 3(a)(iii)

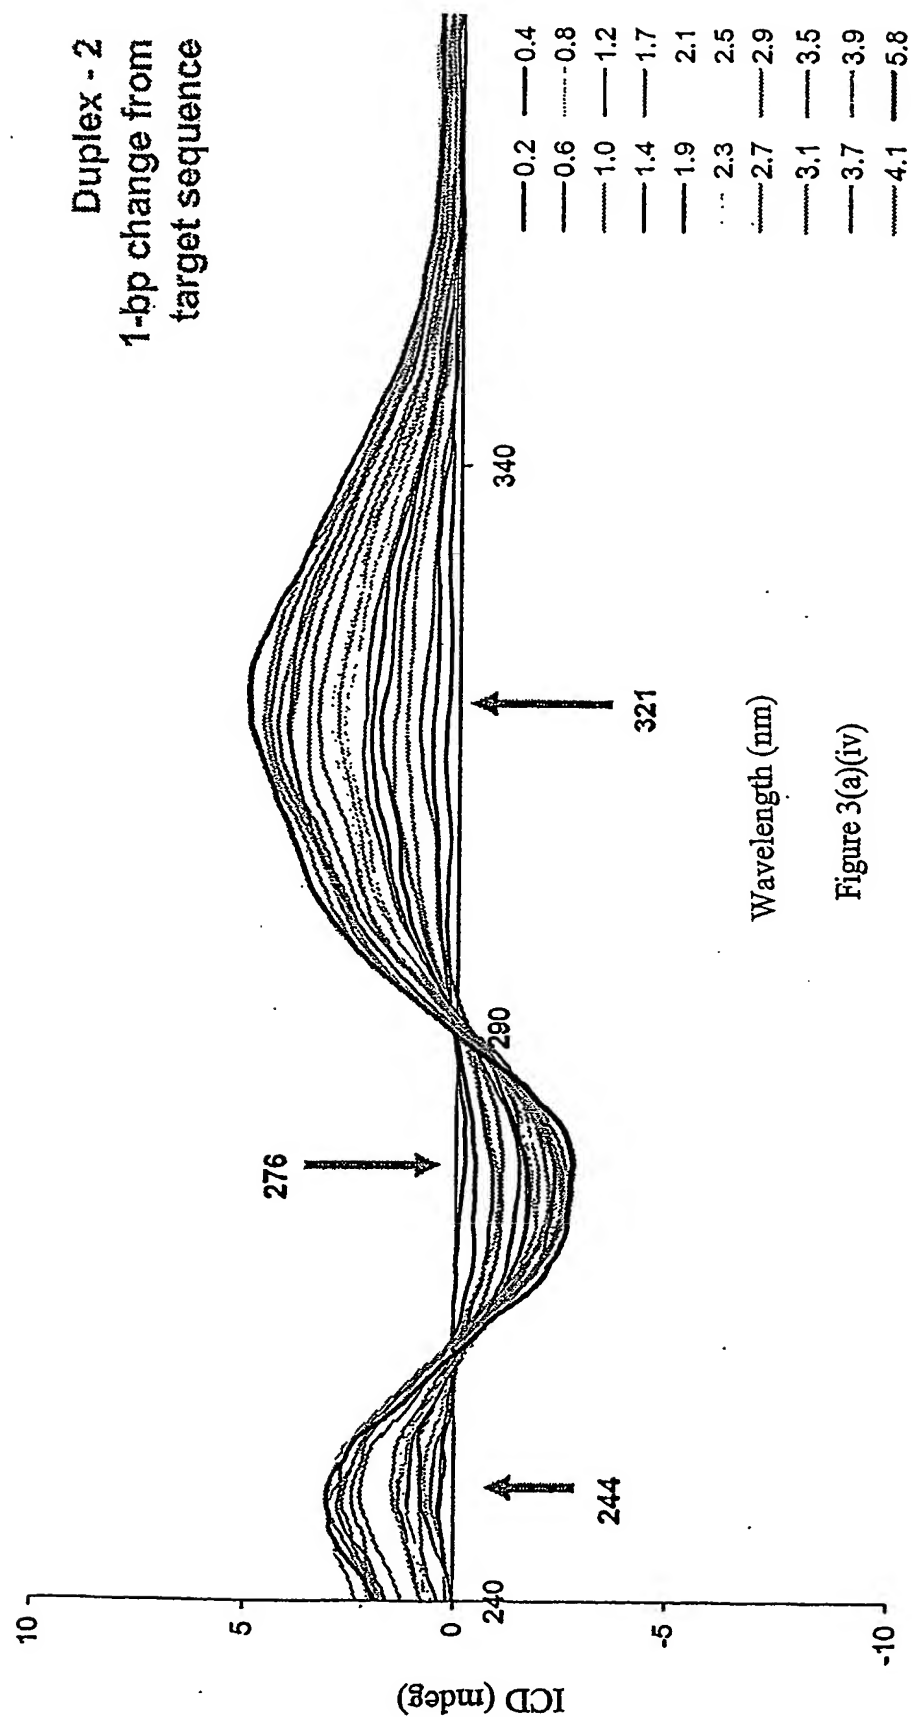


Figure 3(a)(iv)



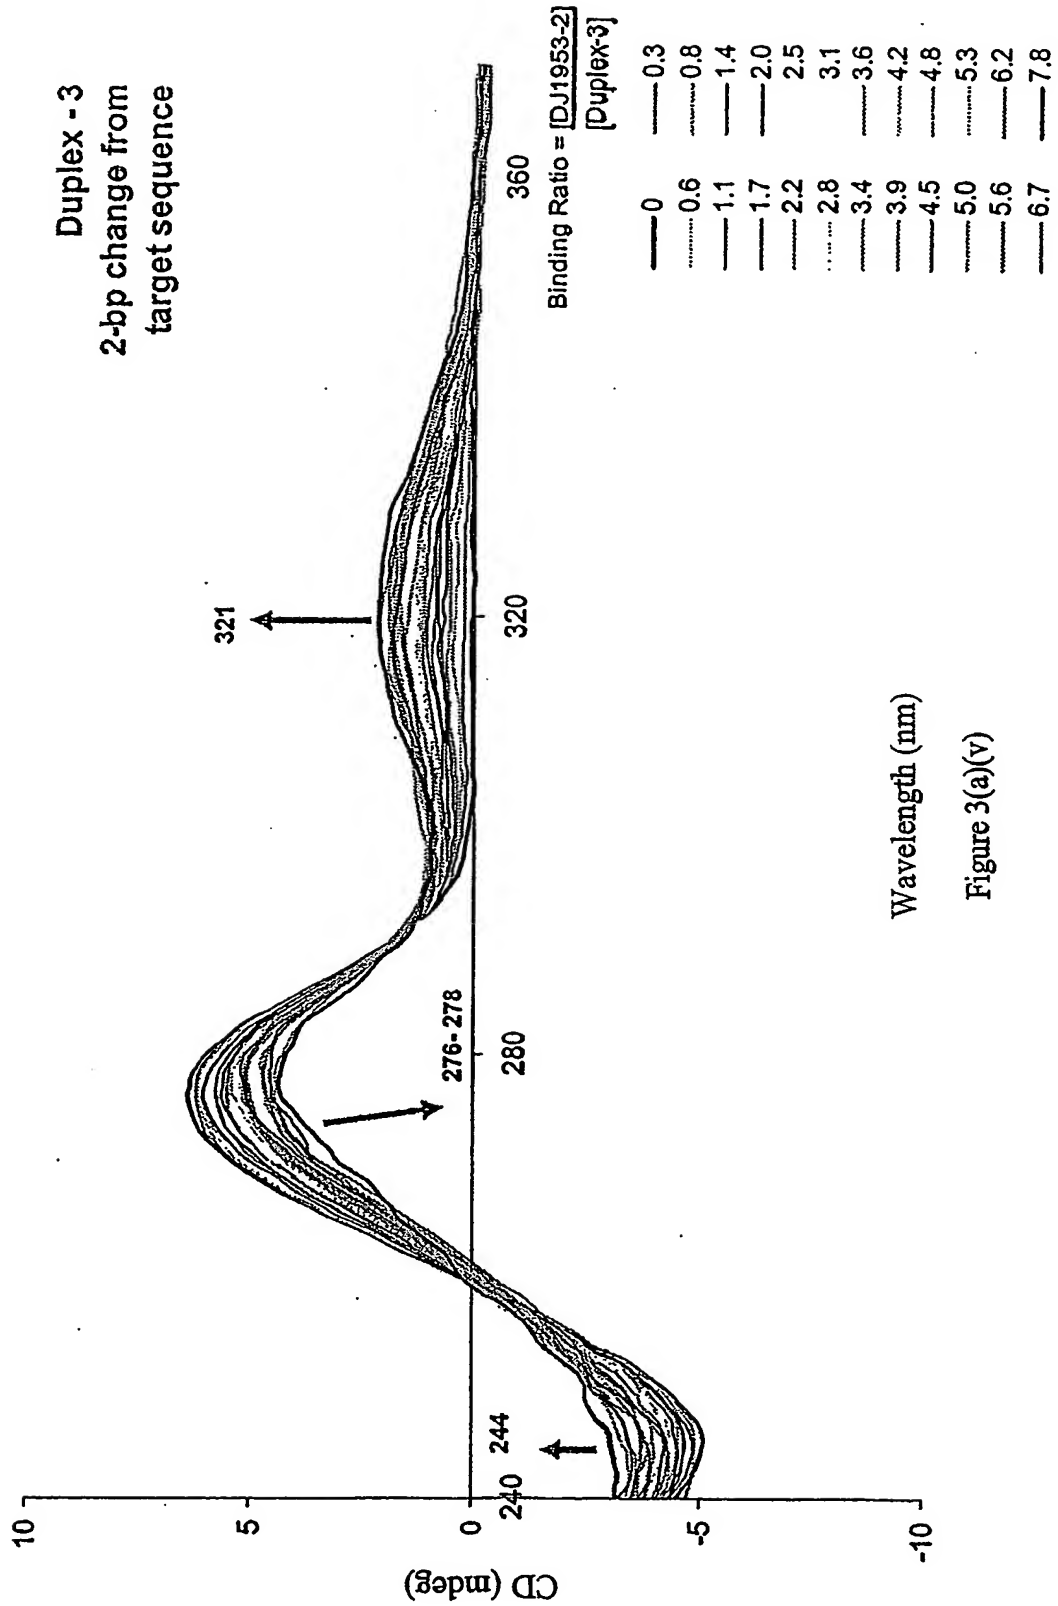


Figure 3(a)(v)

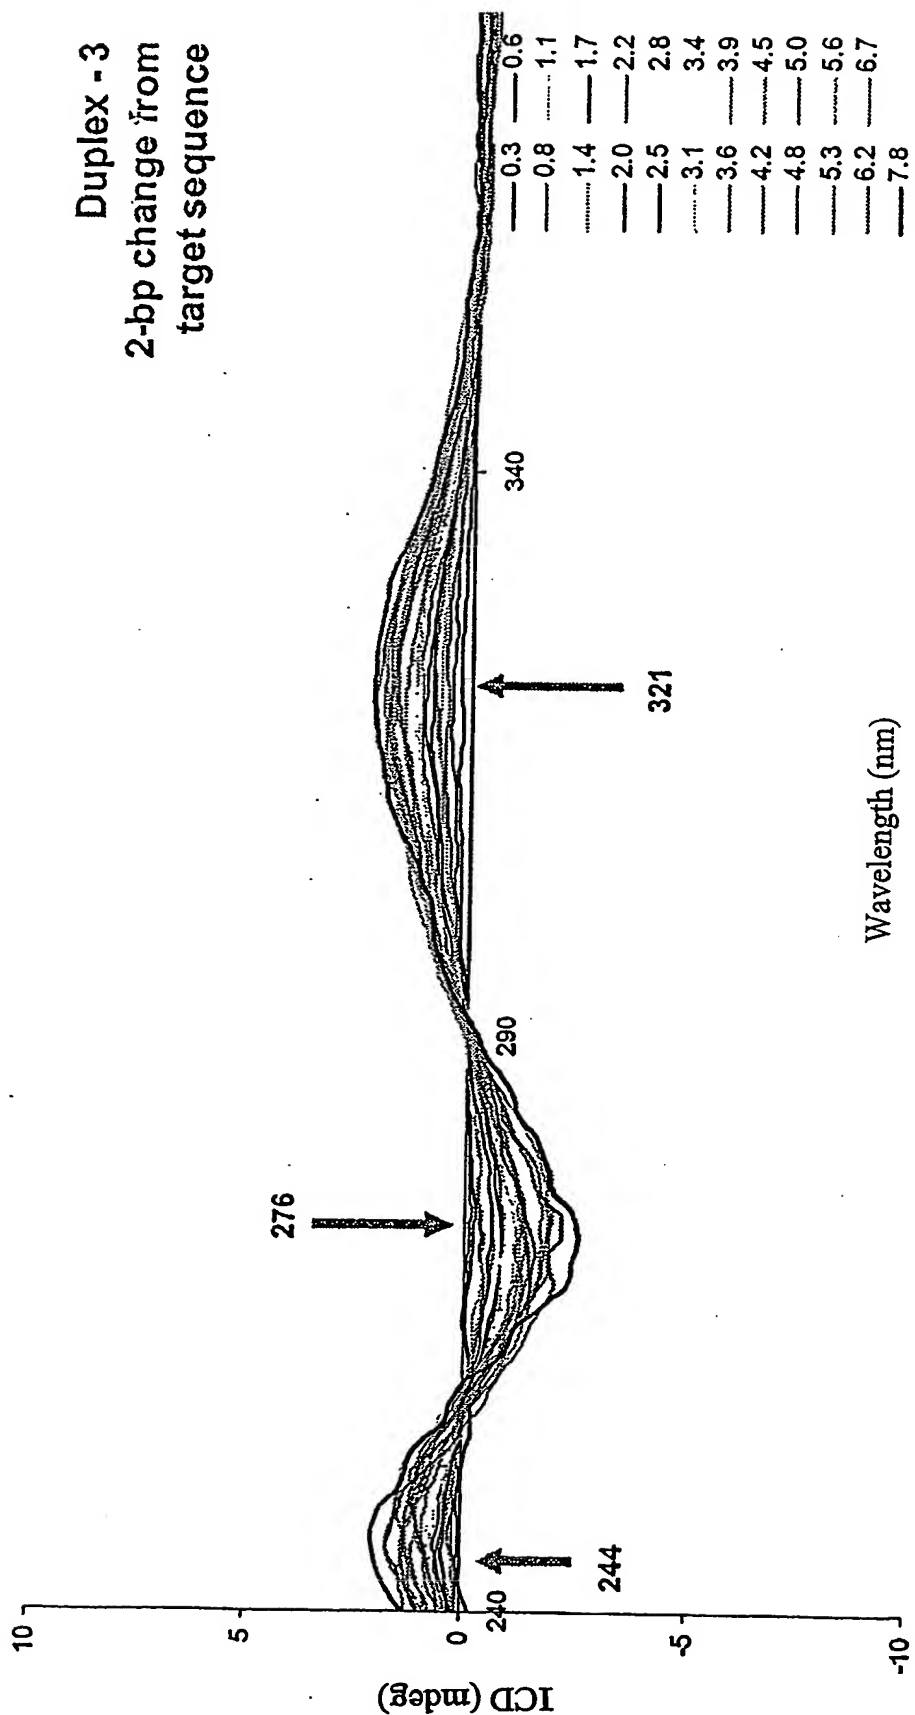

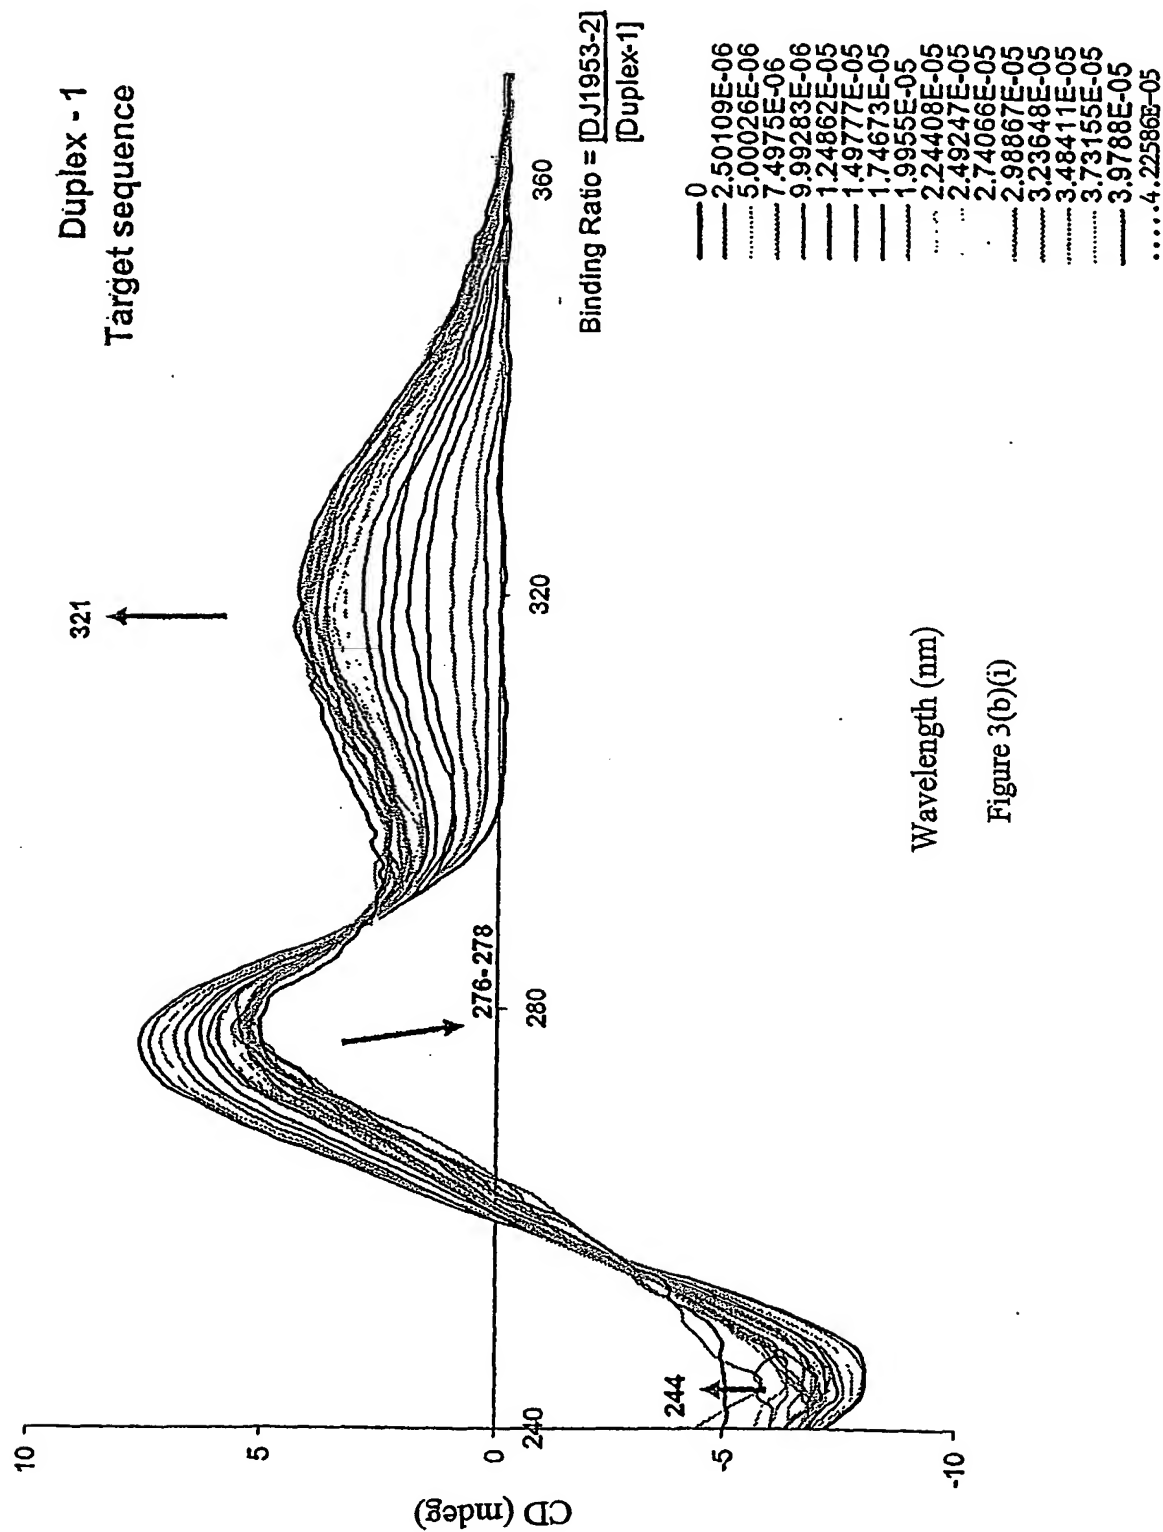

9/19



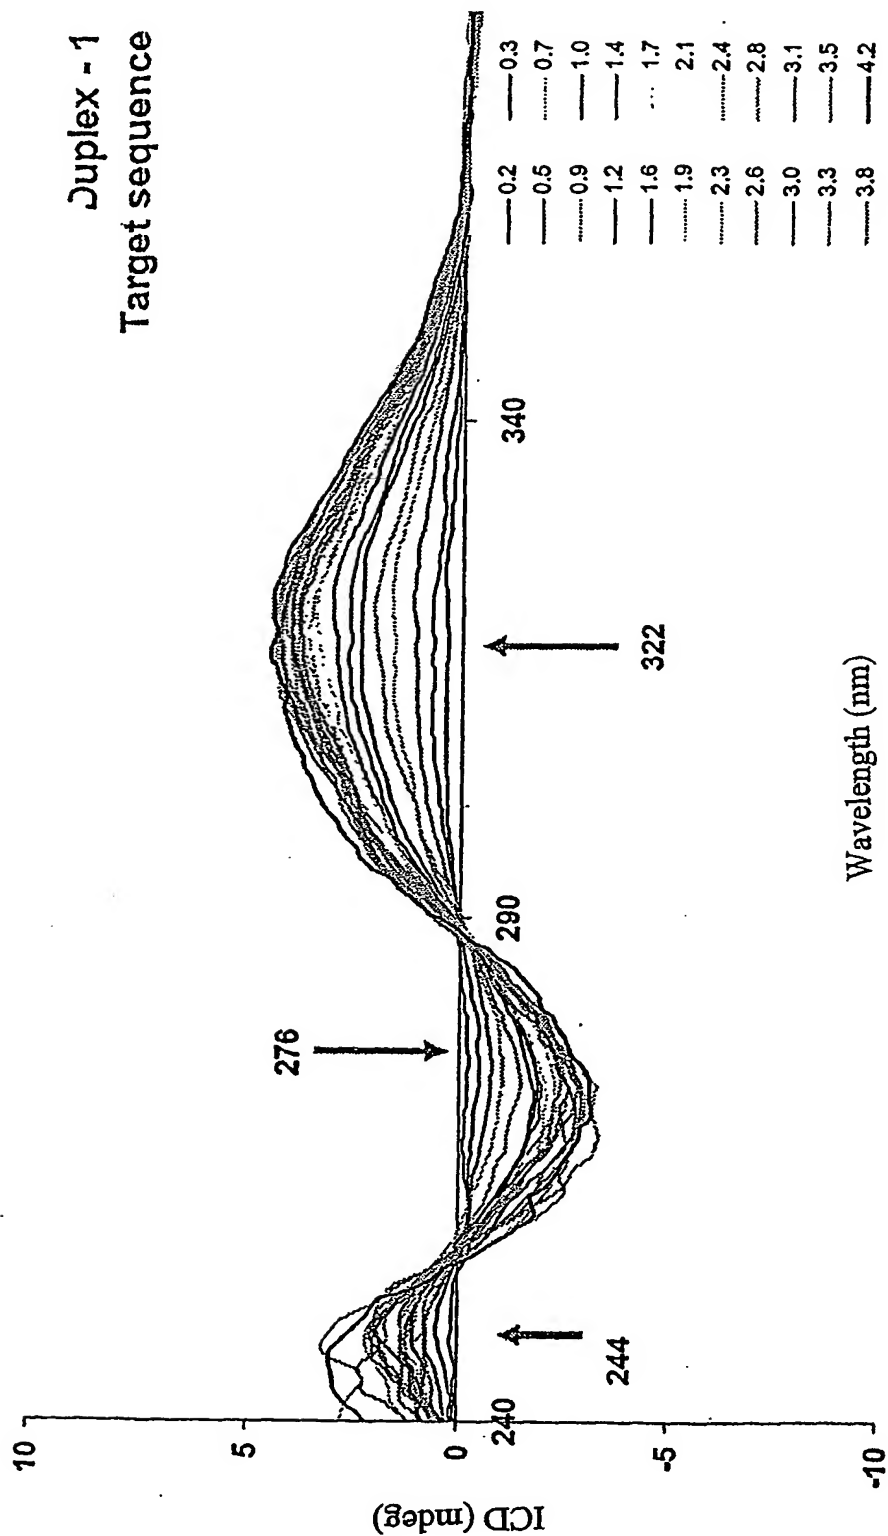


Figure 3(b)(ii)


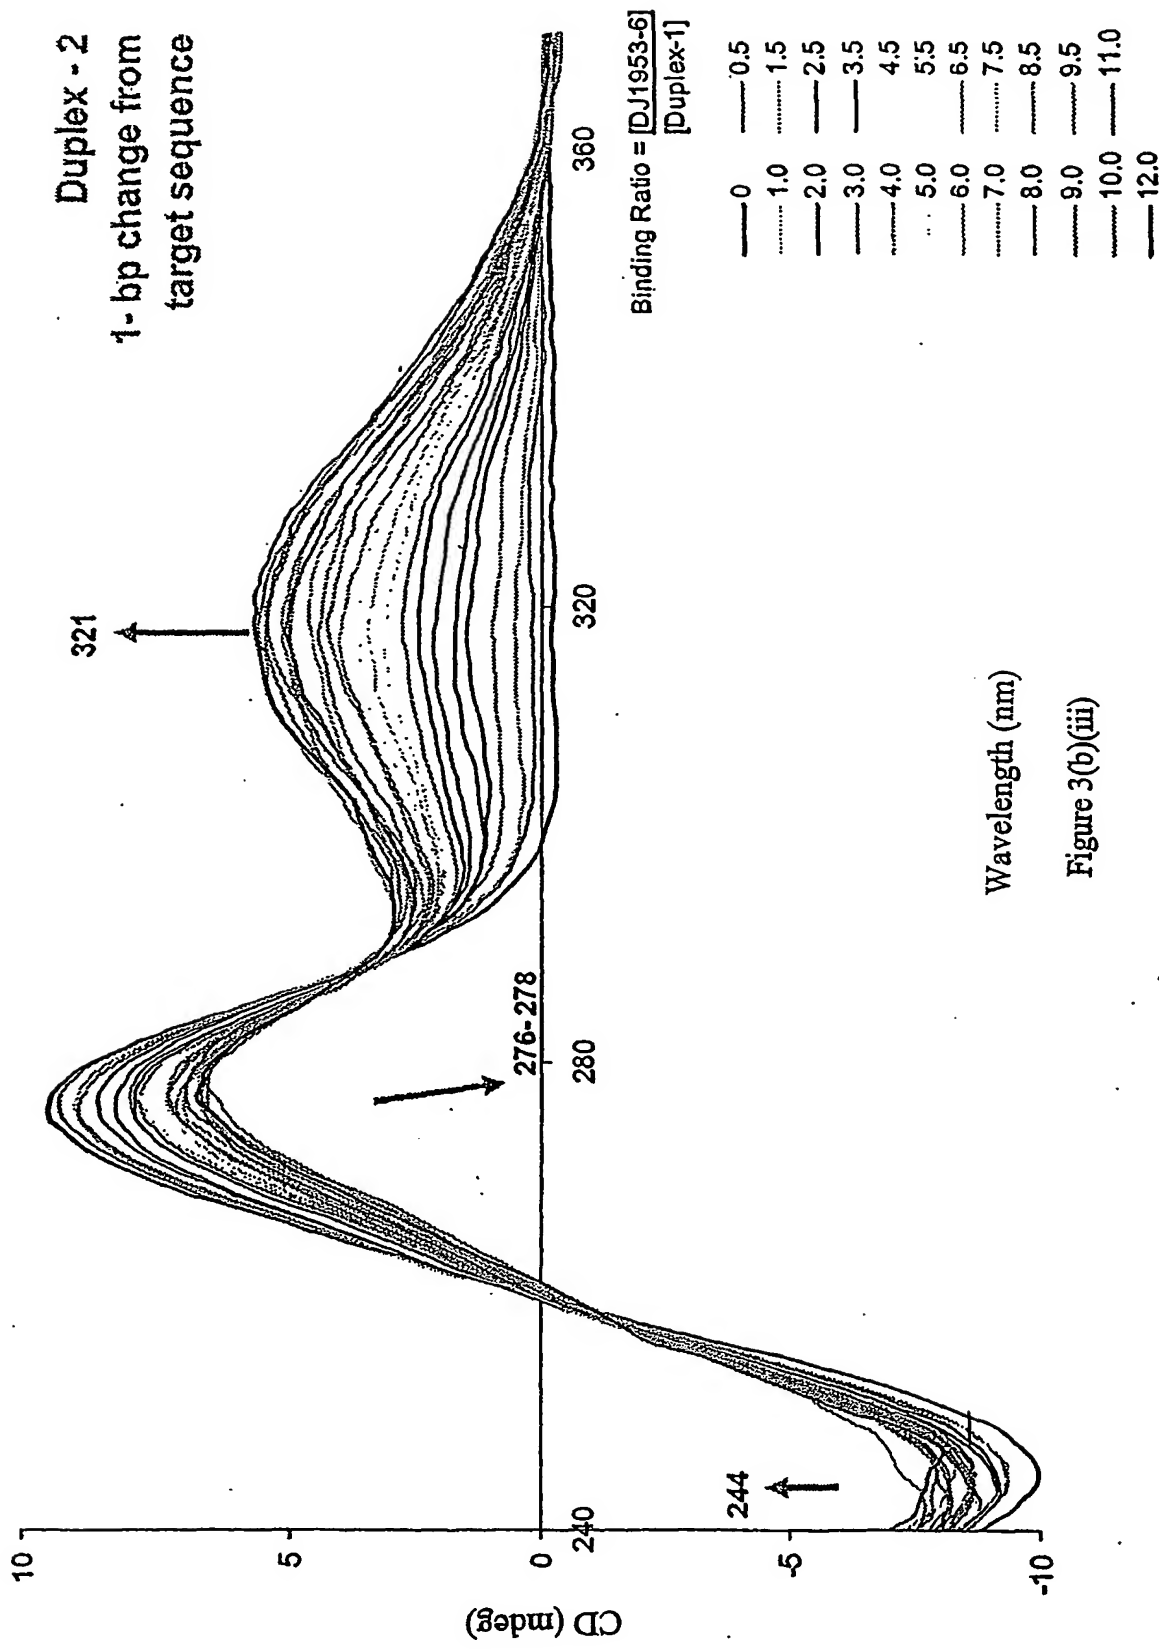



Figure 3(b)(iii)


Duplex - 2  
1-bp change from  
target sequence

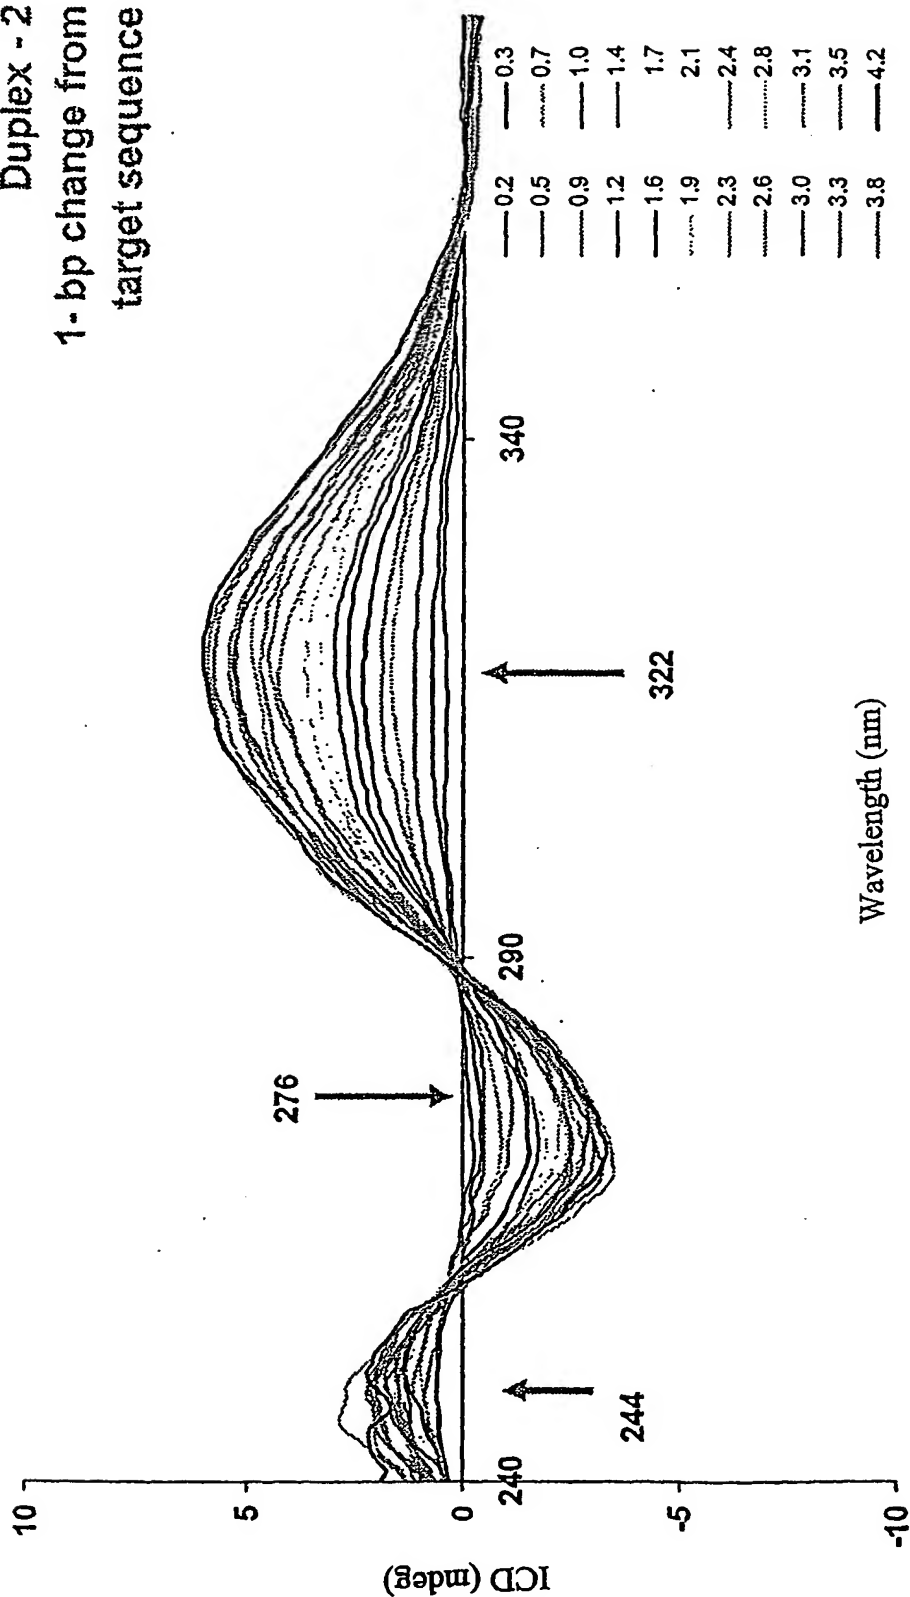


Wavelength (nm)

Figure 3(b)(iv)

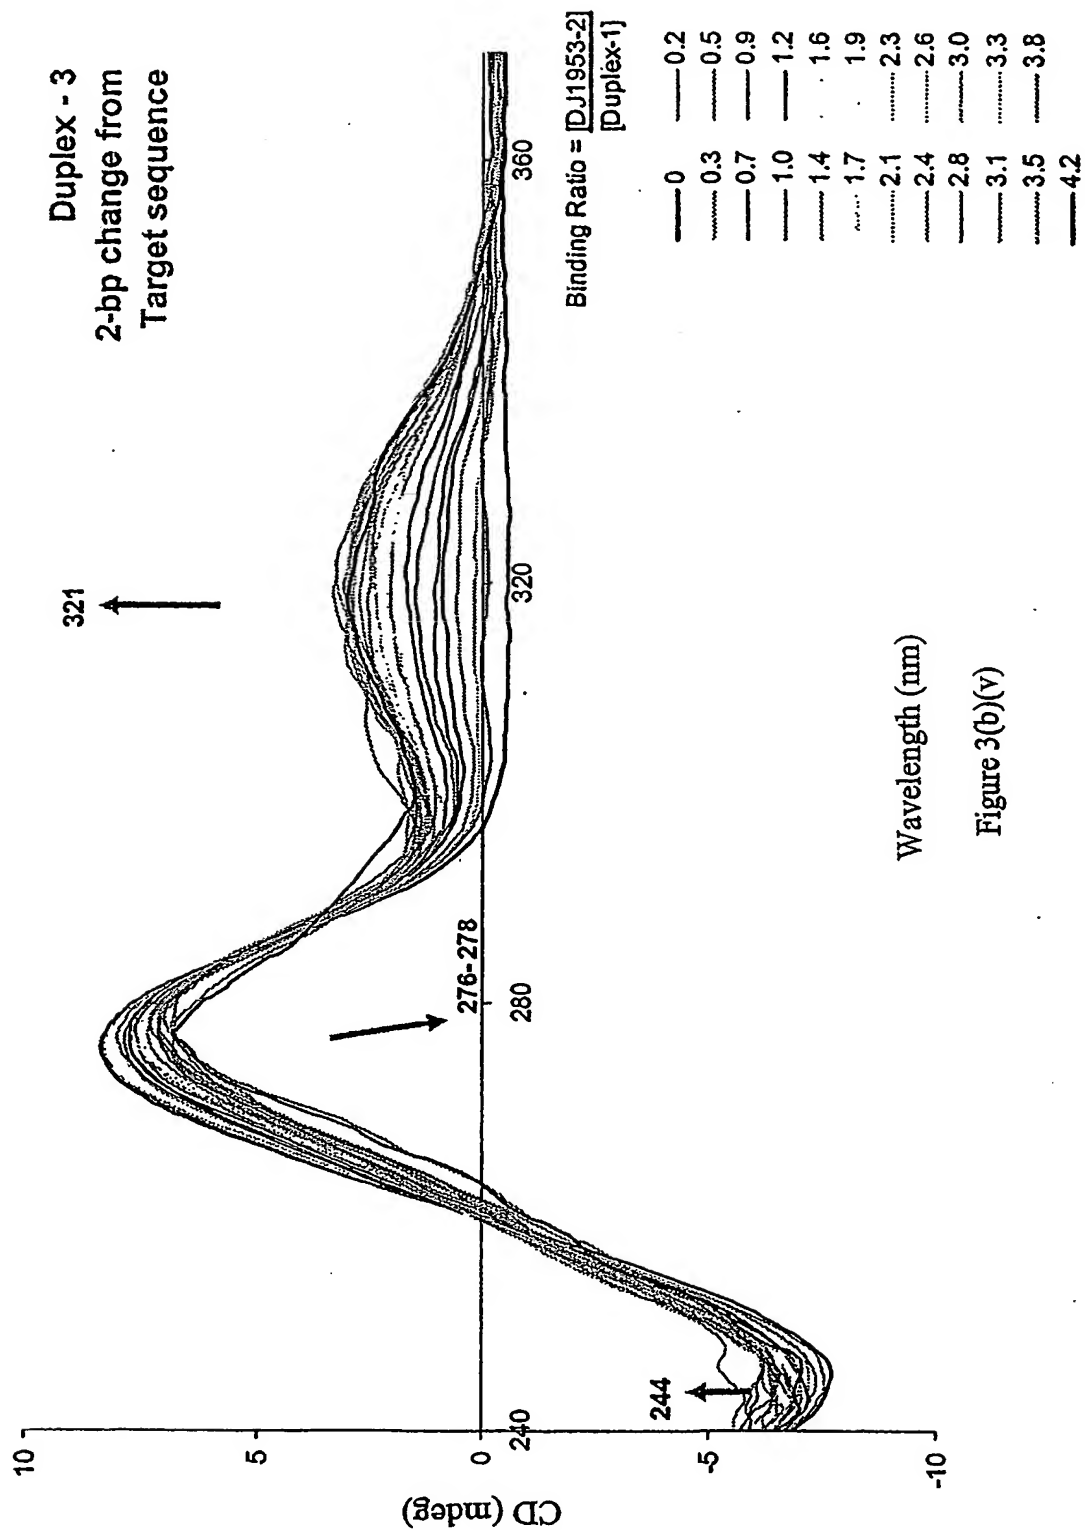

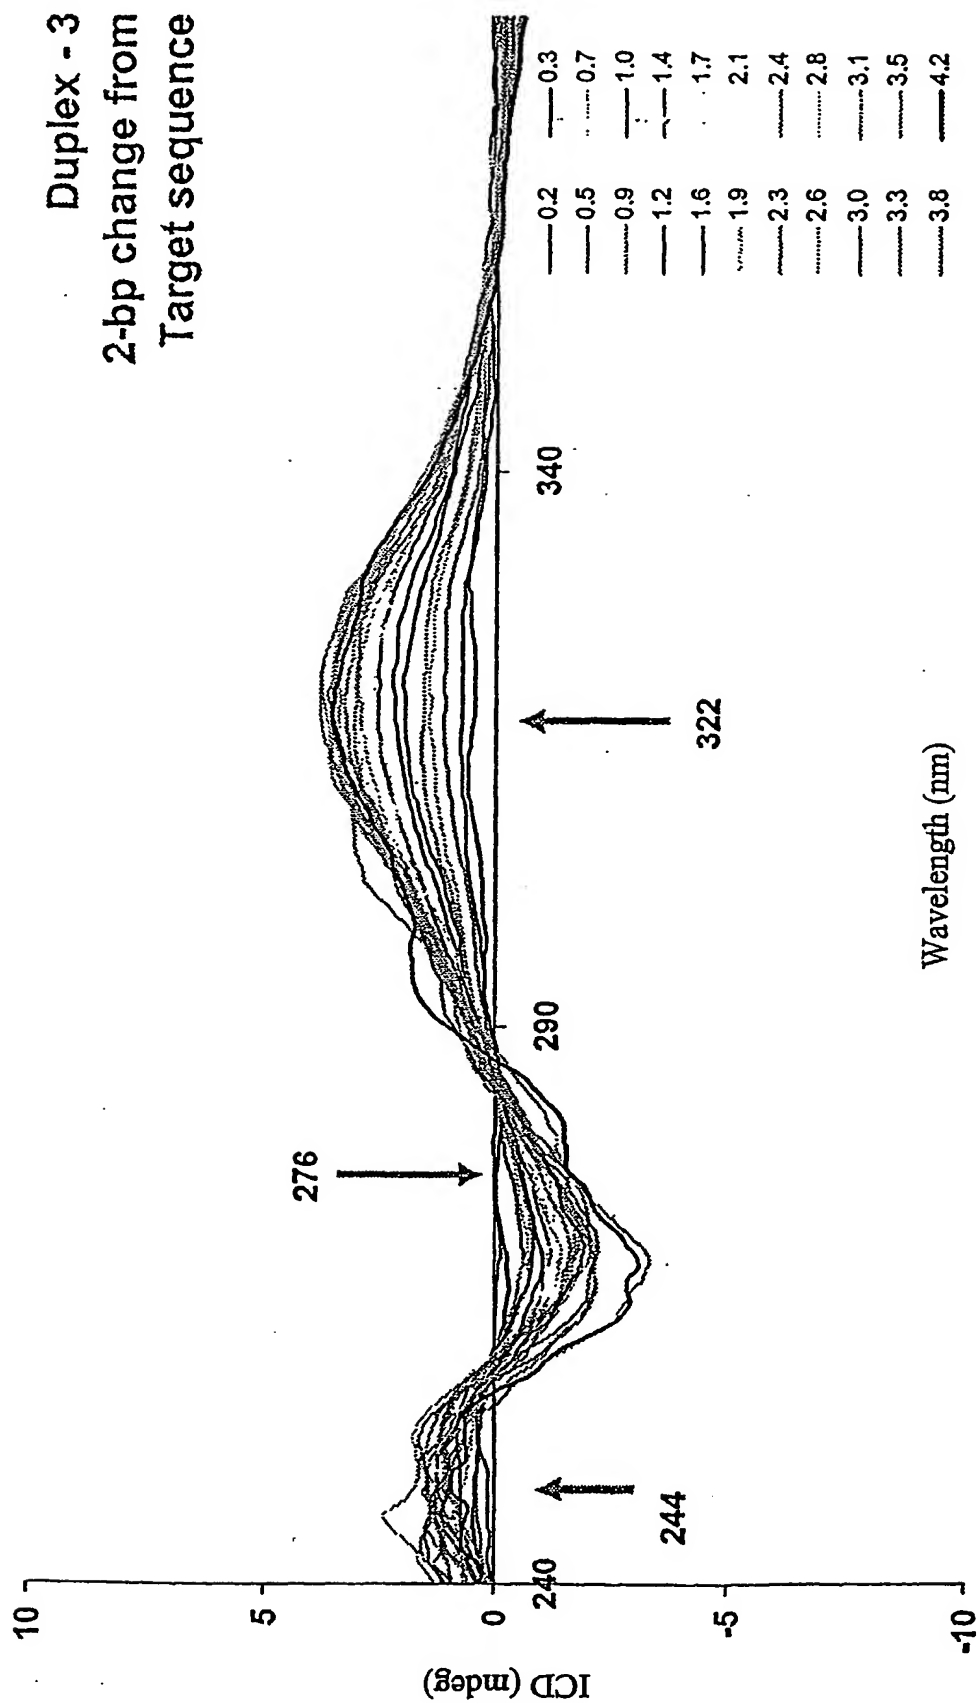

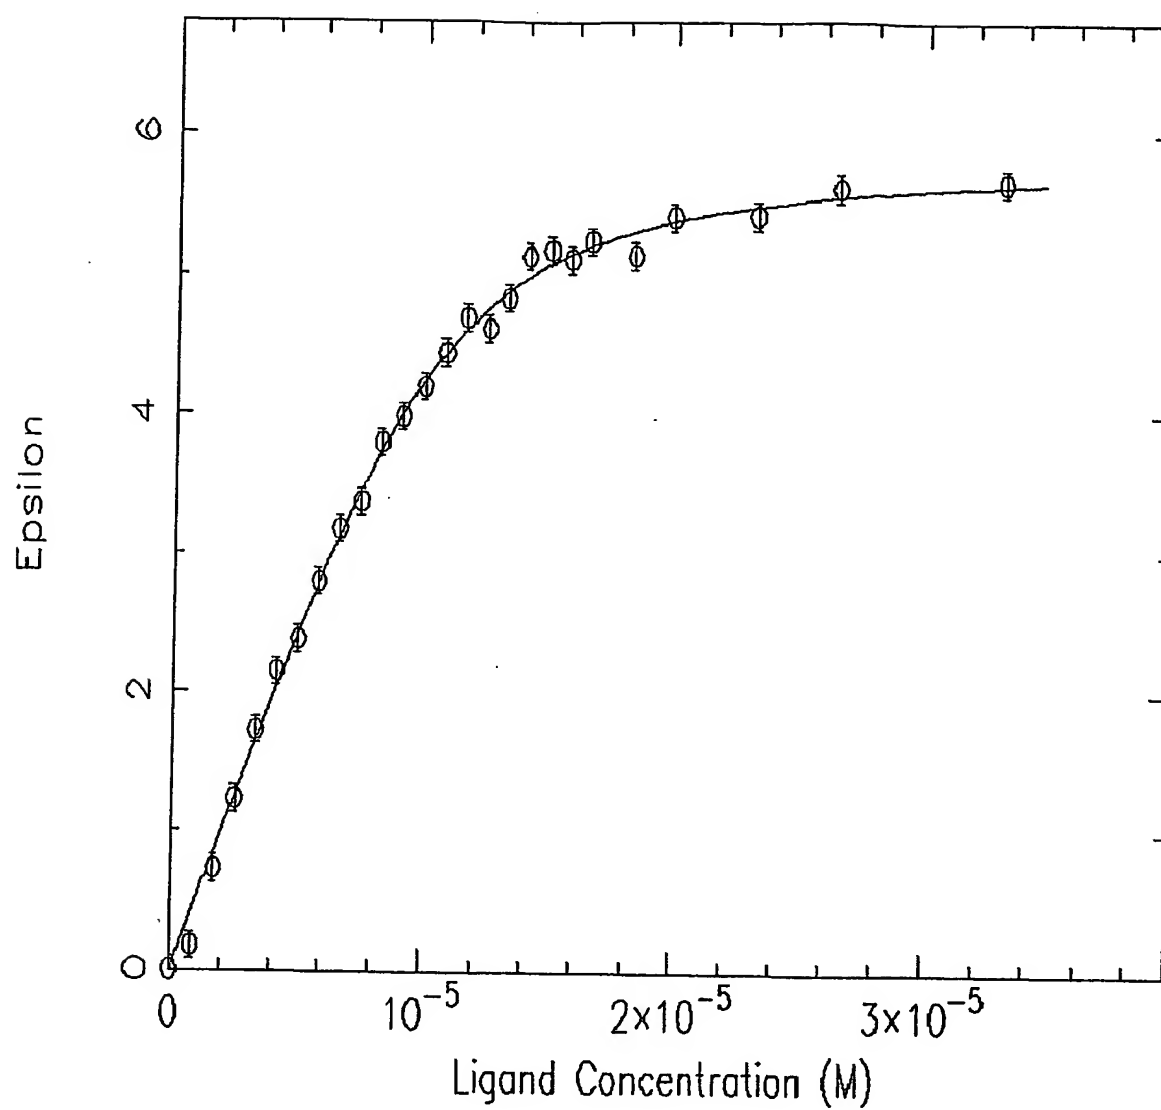**Figure 3c**


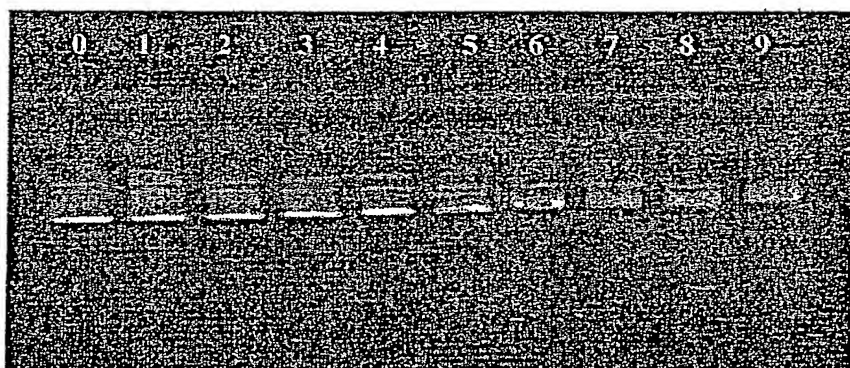


Figure 4

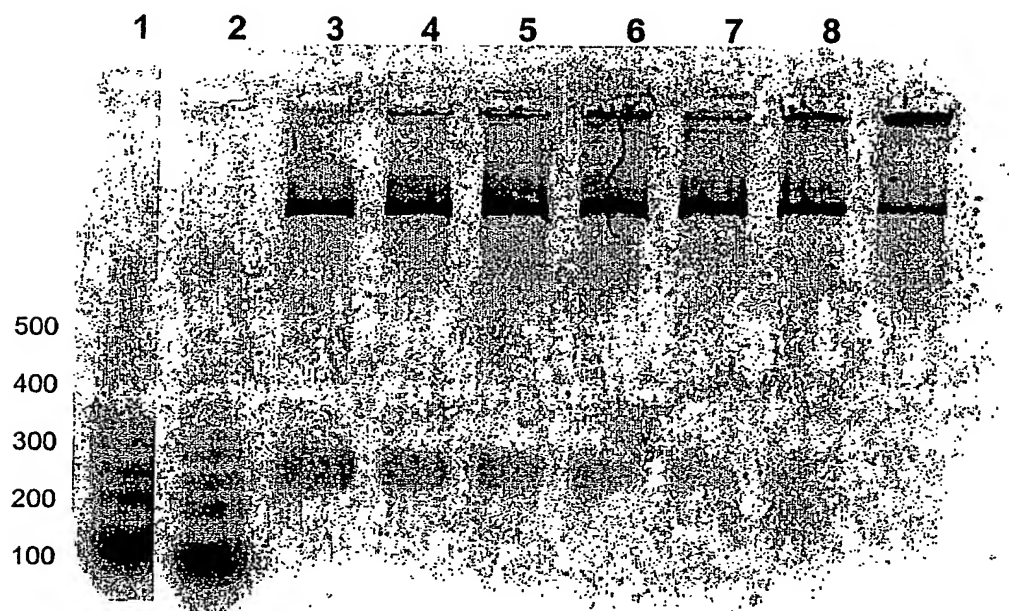

17/19

**Figure 5**

18/19

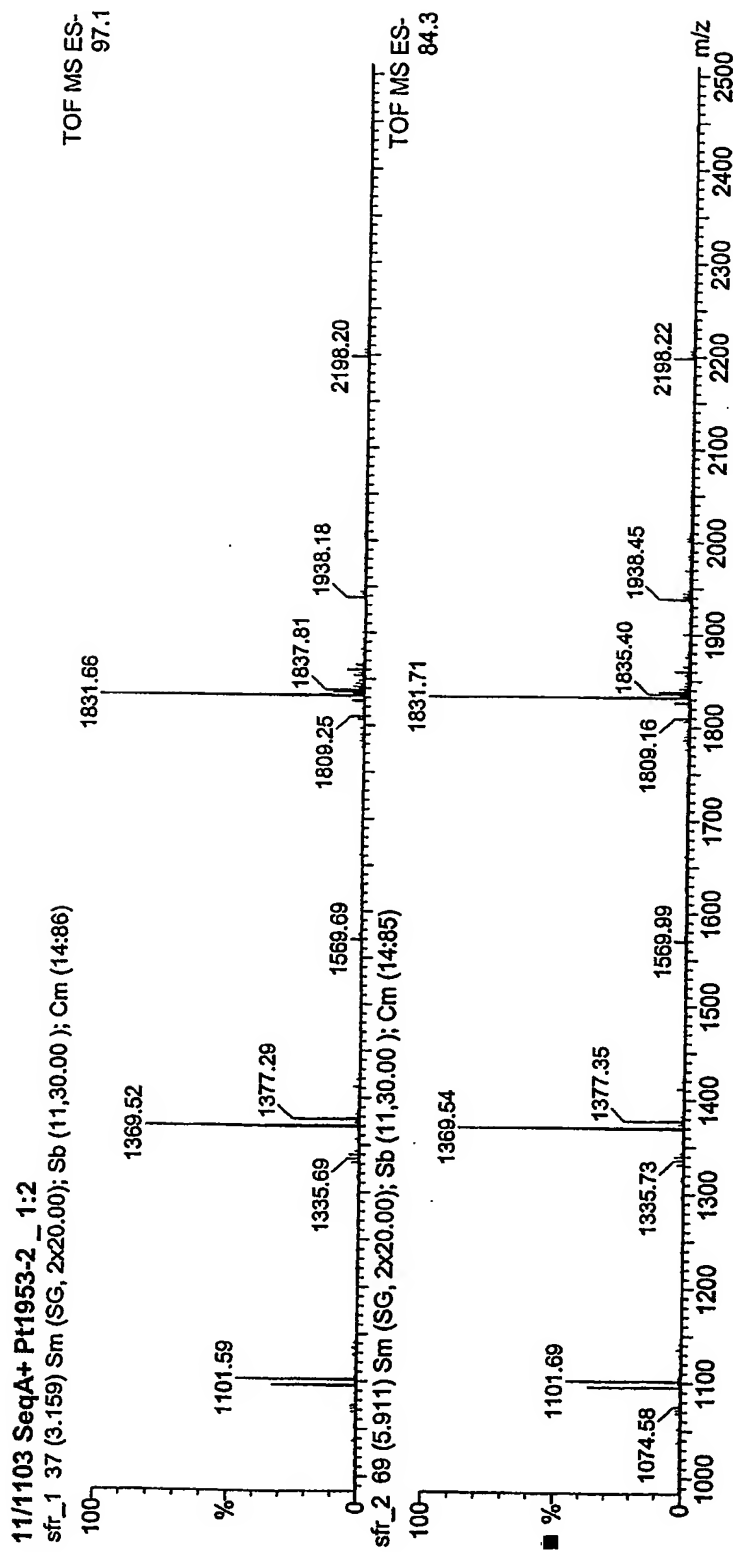


Figure 6

19/19

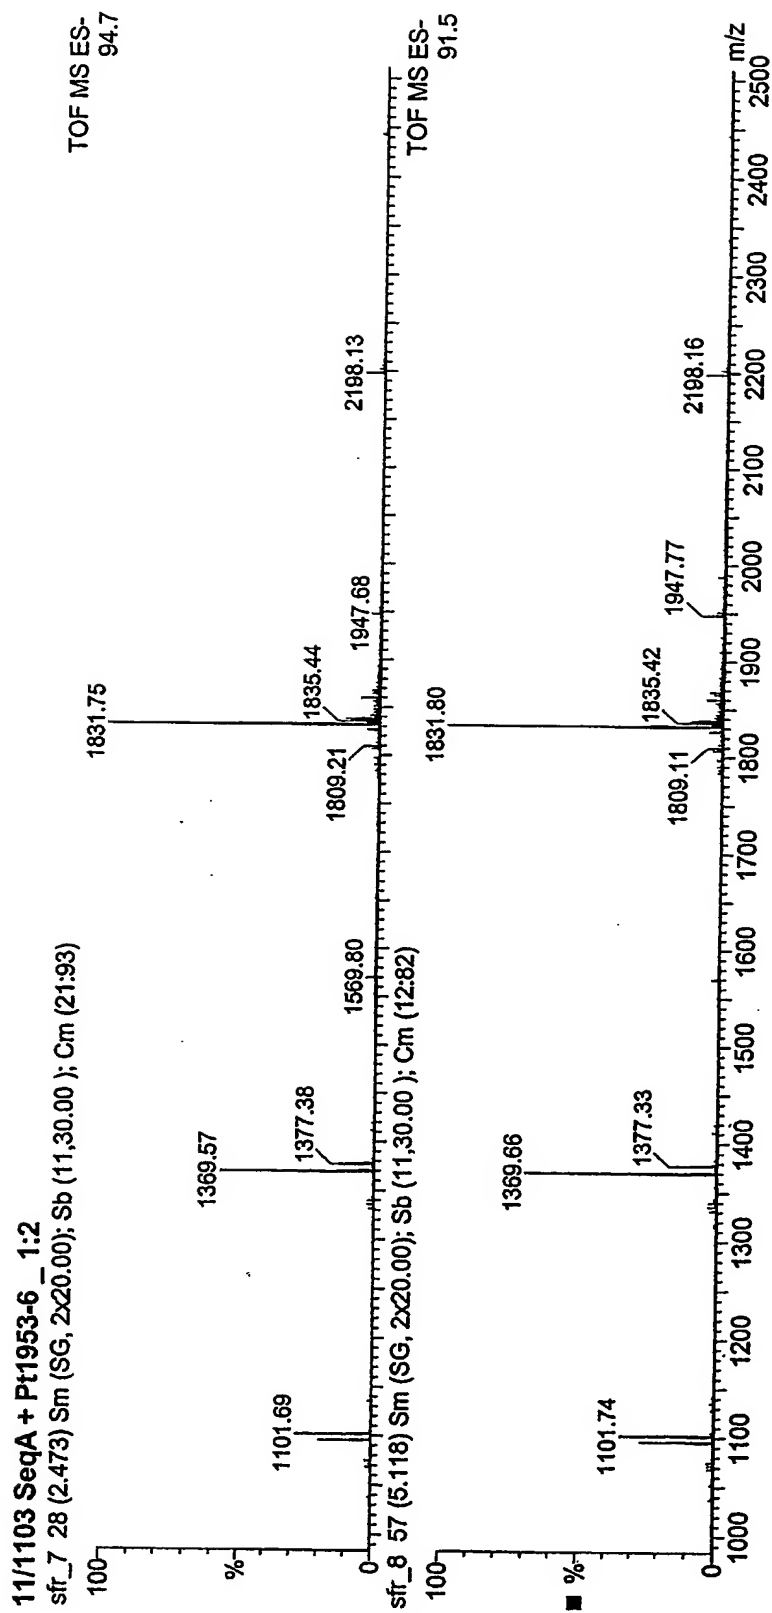


Figure 7

**This Page is Inserted by IFW Indexing and Scanning  
Operations and is not part of the Official Record**

**BEST AVAILABLE IMAGES**

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images include but are not limited to the items checked:

- ☐ BLACK BORDERS
- ☐ IMAGE CUT OFF AT TOP, BOTTOM OR SIDES
- ☒ FADED TEXT OR DRAWING
- ☒ BLURRED OR ILLEGIBLE TEXT OR DRAWING
- ☐ SKEWED/SLANTED IMAGES
- ☐ COLOR OR BLACK AND WHITE PHOTOGRAPHS
- ☐ GRAY SCALE DOCUMENTS
- ☒ LINES OR MARKS ON ORIGINAL DOCUMENT
- ☒ REFERENCE(S) OR EXHIBIT(S) SUBMITTED ARE POOR QUALITY
- ☐ OTHER: \_\_\_\_\_

**IMAGES ARE BEST AVAILABLE COPY.**

**As rescanning these documents will not correct the image problems checked, please do not report these problems to the IFW Image Problem Mailbox.**